

Application Note 1031: TAZ-MS303 and TAZ-MS303W 3-Pole Disconnect Applications

Author **Rey Bartra** | Engineer, M&P Applications and IBU

Contributors **Joe Vaughan** | Manager, Applications Training & Documentation

Table of Contents

1. Introduction	3
2. Installation Manuals	3
3. Warranty Effect.....	4


1. Introduction

This Application Note provides an overview related to the application of a disconnect switch located between the outdoor unit and the indoor units.

2. Installation Manuals

The disconnect switch found on the wiring diagrams of our installation manuals for the M&P equipment is based on the National Electrical Code and only needs to be installed if local or state codes mandate.

The part shown below can be purchased through your Mitsubishi distributor.

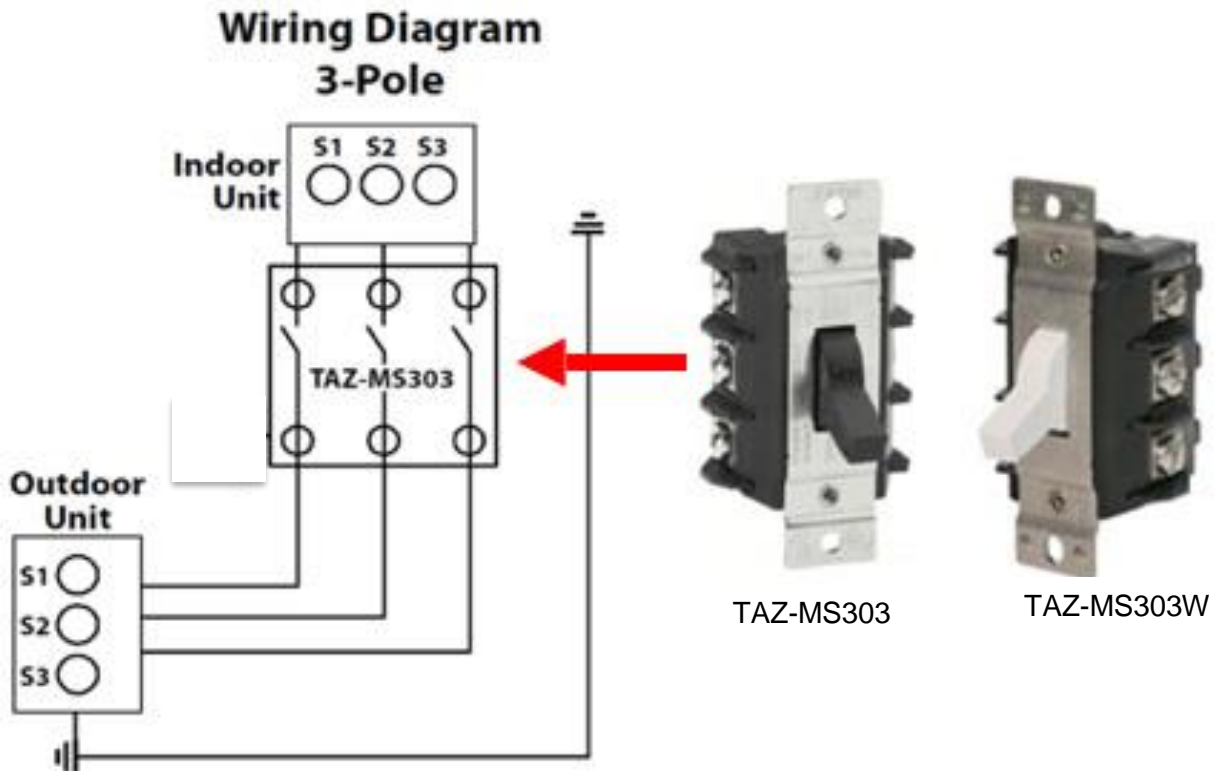

3. Warranty Effect

The installation of the disconnect switch is only a recommendation. Mitsubishi Electric will not void warranty if not installed. Mitsubishi Electric is not responsible for fires, injuries, or death incurred by the lack of this device.